



HOISTWAY CEILING NOT REQUIRED (OPTIONAL) ON UNENCLOSED UNITS

# TYPICAL PLAN

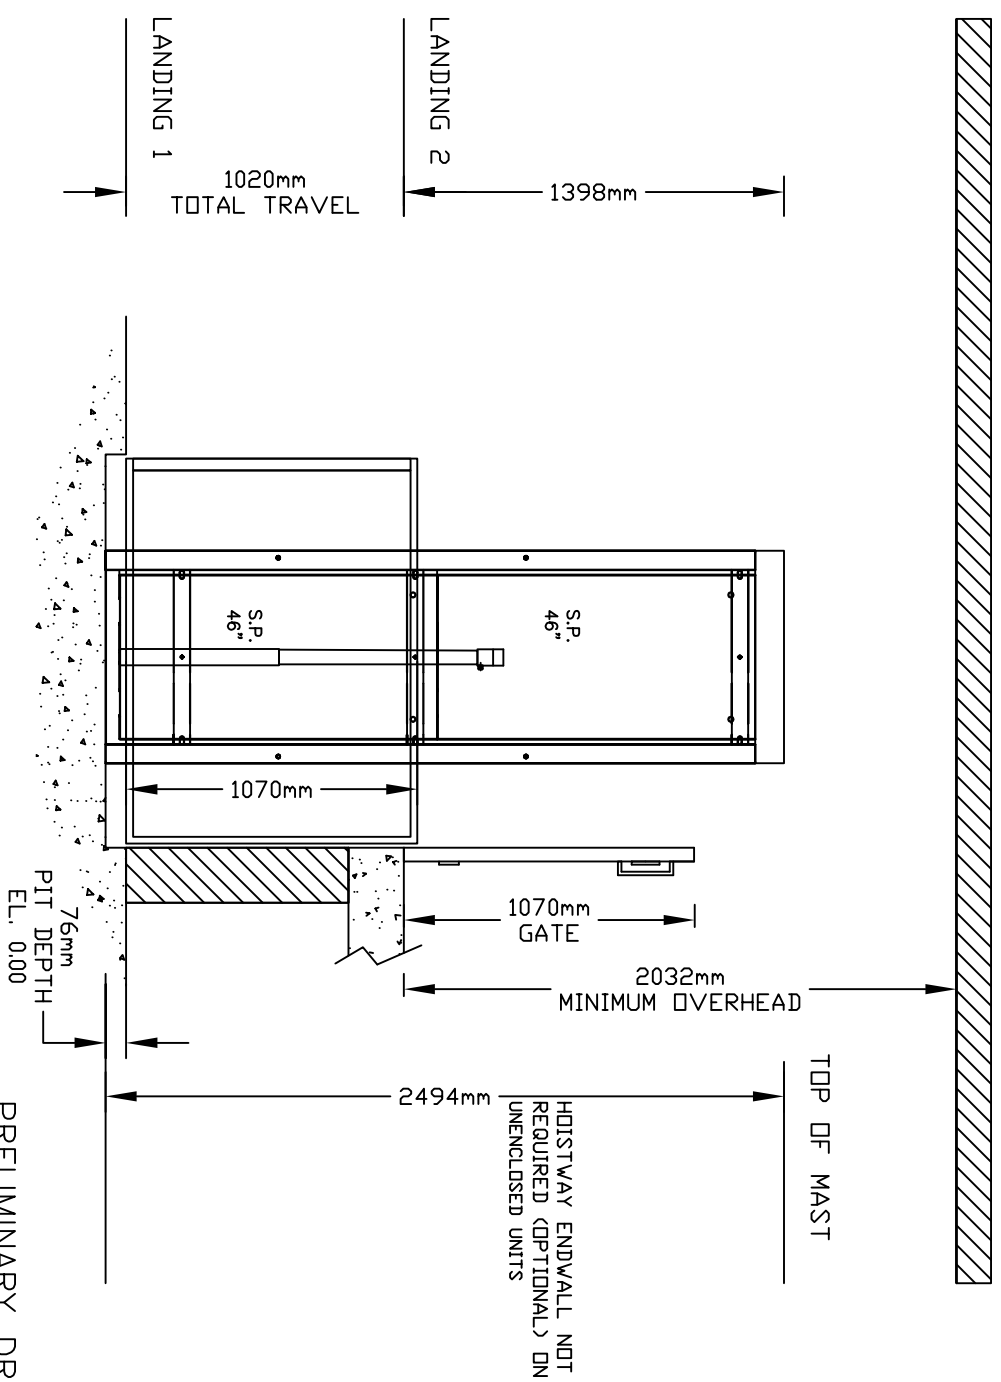

## ELEVATION B-B

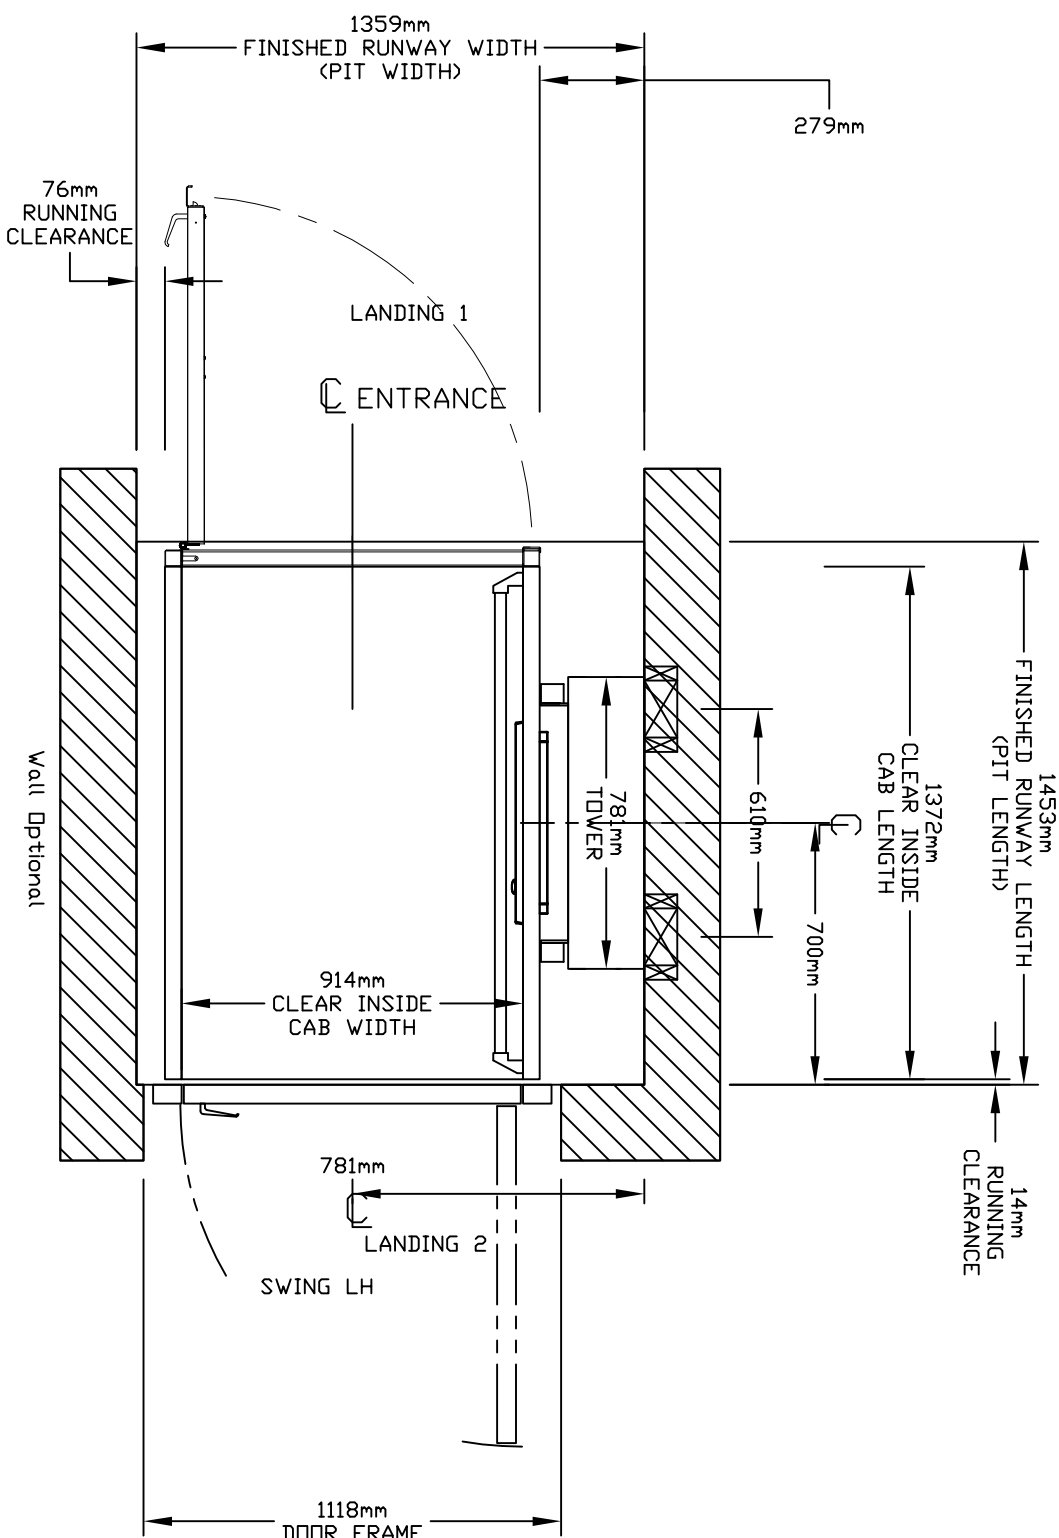

PRELIMINARY DRAWING ONLY  
DRAWING APPROVAL:

THIS DRAWING REFLECTS OUR INTERPRETATION OF THE INFORMATION PROVIDED BY THE DEALER ON THE ORDER FORM. THIS INFORMATION IS THE DEALER'S RESPONSIBILITY, AND IS THE BASIS FROM WHICH THIS LIFT IS DESIGNED AND MANUFACTURED. PLEASE INDICATE THE REQUESTED ACTION BY CHECKING ONE OF THE FOLLOWING BOXES AND SIGNING BELOW TO AUTHORIZE COMPLETION OF THIS ORDER.

APPROVED WITH NO EXCEPTIONS  
MANUFACTURE PRODUCT AS PER DRAWING

APPROVED WITH EXCEPTIONS, NO REAPPROVAL  
REQUIRED  
MAKE CHANGES AS NOTED, NO REAPPROVAL DRAWING REQUIRED


CHANGE AS NOTED, REAPPROVAL REQUIRED  
MAKE CHANGES AS NOTED, SEND CORRECTED DRAWING FOR  
REAPPROVAL BEFORE MANUFACTURE

CHANGES REQUEST:


- \_\_\_\_\_
- \_\_\_\_\_
- \_\_\_\_\_
- \_\_\_\_\_

SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

CAUTION: ONCE THE DRAWING IS APPROVED, JOB CANCELLATION FEES WILL APPLY.

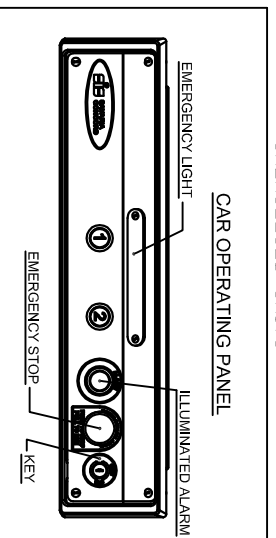

HOISTWAY ENDWALL NOT  
REQUIRED (OPTIONAL) ON  
UNENCLOSED UNITS

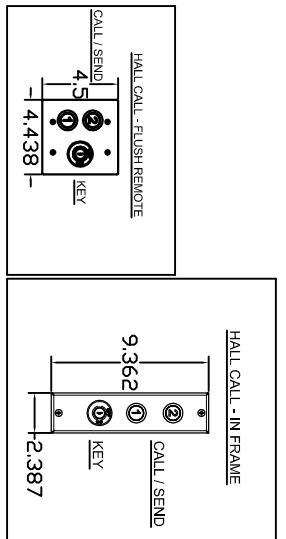

**GENERAL ARRANGEMENT**  
VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER: ANIBAL ROMERO  
PROJECT: MX - NW COPY  
ADDRESS: \_\_\_\_\_

DATE: 10/05/21  
REVISION DATE: 10/13/21  
COMPLETED BY: AROMERO

OFFICE USE ONLY:  
CONFIGURATION VERSION STAMP: 0.0  
MODULE VERSION STAMP: P-S-426

Part No. V-1504  
Variant No. 1029484

**savarida.**  
JOB No. P000000

SHEET No. 1 OF 4

# PROVISIONS BY OTHERS

# SPECIFICATIONS

## GENERAL

**HOISTWAY** – THE HOISTWAY MUST BE DESIGNED AND BUILT IN ACCORDANCE WITH "LIFTS FOR PERSONS WITH PHYSICAL DISABILITIES" OR "PRIVATE RESIDENCES LIFTS FOR PERSONS WITH PHYSICAL DISABILITIES" AND ALL PROVINCIALS AND LOCAL CODES.

**PLUMB RUNWAY** – DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB (-/+ 1/8" (3 mm)) AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.

**MINIMUM OVERHEAD CLEARANCE** – OWNER/AGENT MUST ENSURE MINIMUM OVERHEAD CLEARANCE IS IN COMPLIANCE WITH CODES.

**CONSTRUCTION SITE** – OWNER/AGENT TO PROVIDE ALL MASONRY, CARPENTRY AND DRYWALL WORK AS REQUIRED AND SHALL PATCH AND MAKE GOOD (INCLUDING FINISH PAINTING) ALL AREAS WHERE WALLS/FLOORS MAY REQUIRE TO BE CUT, DRILLED OR ALTERED IN ANY WAY TO PERMIT THE PROPER INSTALLATION OF THE LIFT.

**DIMENSIONS** – CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

## STRUCTURAL

**FLOOR/SUPPORT WALL LOADS** – CONTRACTOR TO ASSURE THAT BUILDING AND SHAFT WILL SAFELY SUPPORT ALL LOADS IMPOSED BY THE LIFT EQUIPMENT. REFER TO THE LOAD DIAGRAM ON THIS DRAWING.

**MAST TO BE SECURELY FASTENED** – WHERE REQUIRED THE MAST MUST BE SECURELY FASTENED TO THE STRUCTURAL SUPPORT WALL. REFER TO WALL / FLOOR SUPPORT LOAD DIAGRAM AND WALL LAG DIMENSIONS ON THIS DRAWING.

**WHERE DOORS ARE REQUIRED** – SUITABLE LINTELS MUST BE PROVIDED BY OWNER/AGENT. DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS.

## ELECTRICAL

**GENERAL** – ELECTRICAL EQUIPMENT AND WIRING TO COMPLY WITH SECTION 38 OF CSA C22.1 (CANADA) OR SECTION 620 OF NEC ANSI/NFPA 70 (USA).

**POWER SUPPLY** – 120VAC, 20A, 60HZ, 1PH CIRCUIT THROUGH A FUSE DISCONNECT WITH AUXILIARY CONTACT ON MAIN POWER SUPPLY. PROVIDE TWO 18 AWG CONDUCTORS BETWEEN CONTACT AND CONTROLLER.

**LIGHTING** – LIGHTING OF 100 LX MIN. AT PLATFORM AND LANDINGS. LIGHTING WITH SWITCH AND ELECTRICAL GFCI OUTLET IN HOISTWAY PIT.

**PHONE** – IF A TELEPHONE CIRCUIT IS REQUIRED, JACK OR PHONE ARE PROVIDED ON THE CAR. A DEDICATED ANALOG PHONE LINE (NO VOIP) IS REQUIRED TO BE PROVIDED BY OTHERS TO THE CONTROLLER FOR VOIP, PLEASE CONTACT SAVARIA.

**SAVARIA LINK REMOTE MONITORING** – NOT APPLICABLE  
Not required



## ENTRANCES

**UPPER LANDING GATES** – WHERE REQUIRED, SMOOTH SOLID BARRIERS ARE TO BE SUPPLIED AND INSTALLED ON BOTH SIDES OF ENTRANCE AT UPPER LEVEL AND MUST BE A MINIMUM OF 42" (1067 mm) HIGH. ENTRANCE ASSEMBLY MUST BE IN PLACE PRIOR TO THIS PROVISION.

**FASCIA PANEL BELOW UPPER LEVEL ENTRANCE** – WHERE REQUIRED, FASCIA PANEL MUST BE FASTENED TO A SOLID WALL AND BE PERPENDICULAR TO THE FLOOR AND WALLS. HOISTWAY FASCIA IS NOT SELF-SUPPORTING FOR LONG, CONTINUOUS RUNS VOID OF ENTRANCES. ADEQUATE SUPPORT FOR THE FASCIA MUST BE PROVIDED.

**ENTRANCE ASSEMBLIES** – ENTRANCE ASSEMBLIES MUST BE ADJUSTED TO ALIGN WITH PLATFORM AND INTERLOCK EQUIPMENT. OTHERS TO ALLOW AN ADEQUATE ROUGH OPENING.

**RETURN WALLS** – RETURN WALLS AT ENTRANCES MUST BE BUILT-IN BY OTHERS AFTER ENTRANCE ASSEMBLIES ARE IN PLACE. ENTRANCE ASSEMBLY MUST BE SECURELY FASTENED TO WALLS.

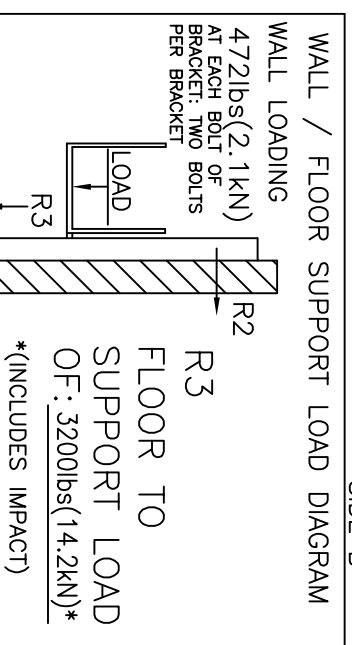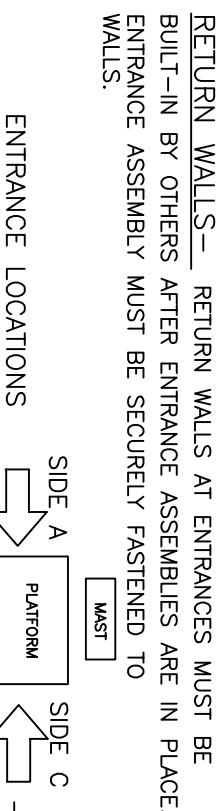

## GENERAL

**CLASSIFICATION:**  
APPLIED CODE:  
SPECIAL NOTE:  
MODEL:  
CAPACITY:  
NOMINAL SPEED:  
TRAVEL:  
PIT DEPTH:  
PLATFORM SIZE:  
POWER SUPPLY:  
BATTERY BACK UP:

Vertical Wheelchair Platform Lift  
ASME A18.1-2008 Section 5 Priv  
V-1504 Shaftway or Decklift  
750 lbs (341 kg)  
20 fpm (0.102 m/s)  
40.16" (1020 mm)  
3" (76 mm)  
36" X 54" (914 mm X 1372 mm)  
120V,20A,60HZ,SINGLE PHASE  
down direction only

JACK UNIT  
STROKE: 24" (610 mm)  
PLUNGER O/D: 1.5" (38 mm)  
CYL. O/D: 2.125" (54 mm)  
CYL. I/D: 1.75" (44 mm)

CONTROLLER  
MODEL: V-1504  
TYPE: CPFS  
OPS #: LR1390-7R2  
AMP: 100 A  
MFR.: SAVARIA


## POWER UNIT

MOTOR: 3.0 HP, 24V DC  
FLOW: 1.15 Gal/min (4.35L/min)

CAB FINISH: STEEL W PAINT

HYDRAULIC DATA  
OIL TYPE: UNIVIS 32 INDOOR DEXRON ATF OUTDOOR  
GALLONS REQ'D: 1.0 Gal (3.79 L)  
MAXIMUM WORKING PRESSURE: 2500 psi (17.2 MPa)  
RELIEF PRESSURE: WPx125% MAX.  
MAXIMUM RELIEF PRESSURE: 2500 psi (17.2 MPa)  
HYDRAULIC HOSE: 1/4" (6.4 mm) ID  
BURST: 20000 psi (137.9 MPa)  
FITTINGS: 1/4" (6.4 mm) NPT MALE

SUSPENSION CHAIN  
2X #50 ROLLER CHAIN  
BREAKING STRENGTH: 7171 lbs (31.9 kN) each  
SAFETY BRAKE: TYPE 'A'

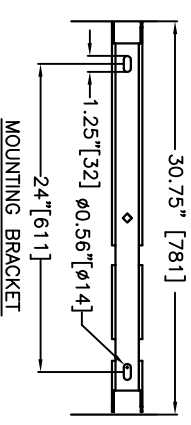

## DOORS / GATES / CALL STATIONS

	LANDING 1	LANDING 2	LANDING 3	LANDING 4
DOOR TYPE	Platform Gate	42" - 1067mm Landing Gate		
ENTRANCE SIDE	d	c		
DOOR SWING	lh	lh		
DOOR INSERT	Tempered Glass	Tempered Glass		
LOCK TYPE	WR500 Lock (24V)	WR500 Lock (24V)		
AUTO DOOR OPENER	None	None		
CUSTOM DOOR WIDTH				
CUSTOM DOOR HEIGHT				
IN FRAME CALL STN.	no	yes		
CALL STN. TYPE	Call/Send Buttons	Call/Send Buttons		
CALL STN. KEYED	Off Pos. Removable	Off Pos. Removable		
CALL STN. STOP BUTTON	no	no		
CALL STN. MOUNTING	Flush Mounted Remote	Flush Mounted In Frame		
INSULATED PRODOOR KIT				

## OPTIONS PROVIDED


EMERGENCY PENDENT PLUG IN MANUAL LOWERING BOX  
WINGS: no  
TOUCH UP PAINT: 1 can(s)  
BUILDING: Private Building  
LIGHT CURTAIN: no  
PHONE OR PHONE PLUG: No Phone, Plug Incl  
FLOOD SWITCH: no  
REMOTE MACHINE ROOM: Not required  
LOCATION: OUTDOOR

OFFICE USE ONLY:	Part No.	V-1504
CONFIGURATION VERSION STAMP:	Version No.	1029484
MODULE VERSION STAMP:		


**DATA SHEET**  
VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER: ANIBAL ROMERO  
PROJECT: MX - NW COPY  
ADDRESS: [Redacted]  
DATE: 10/05/21  
REVISION DATE: 10/13/21  
COMPLETED BY: AROMERO  
JOB No. P000000  
SHEET No. 2 OF 4


LOADS CALCULATED ON BASED ON ANCHOR POINTS EVERY 48" EVERY TOWER SECTION NEEDS TO BE ANCHORED. IF SPACING IS INCREASED, LOADS PER BRACKETS WILL INCREASE ACCORDINGLY

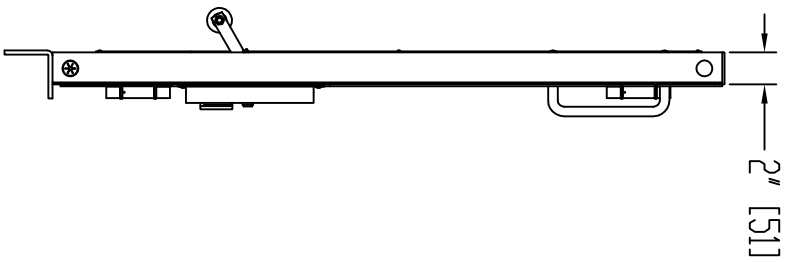


SIDE VIEW




WALL ATTACHMENT  
(8X) #8 X 3 FH SCREWS  
(SHIM AS REQUIRED)




LEFT HAND SWING

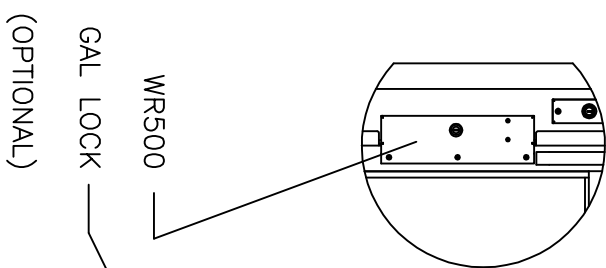


HALL CALL  
(OPTIONAL)

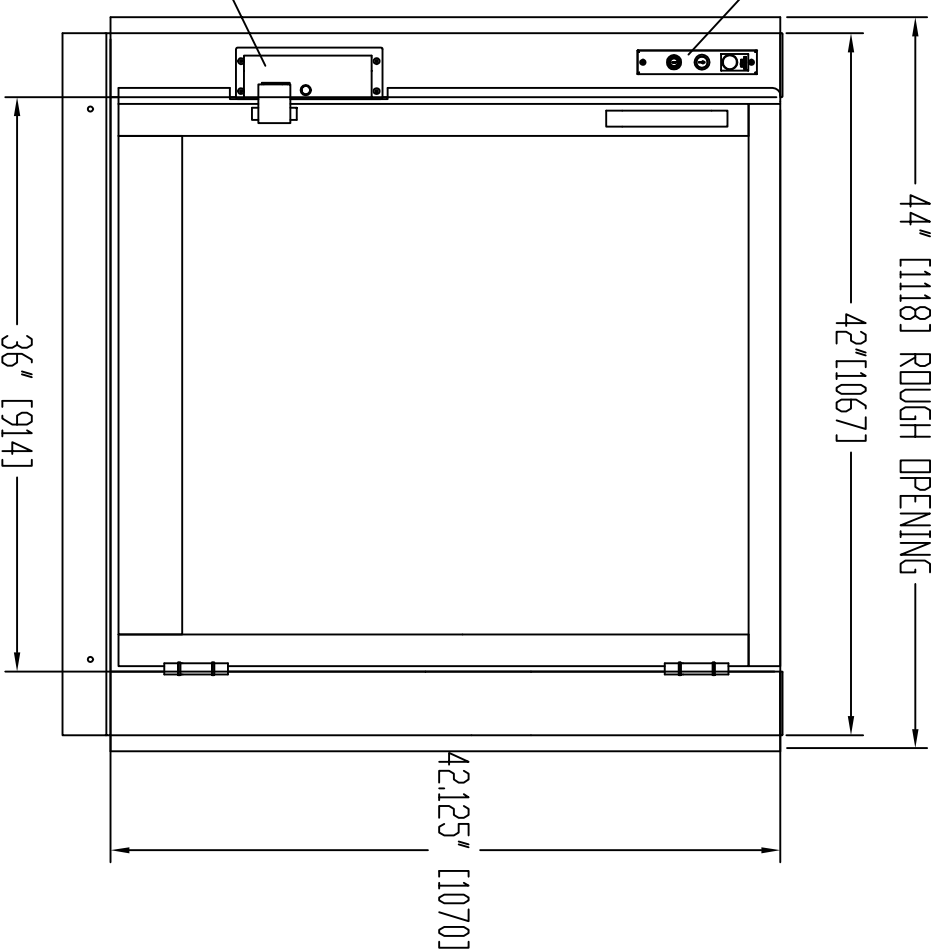


FRONT VIEW

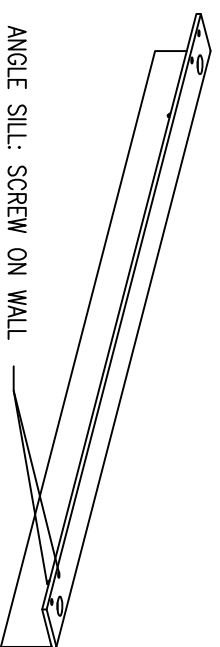

ANGLE SILL: SCREW ON WALL

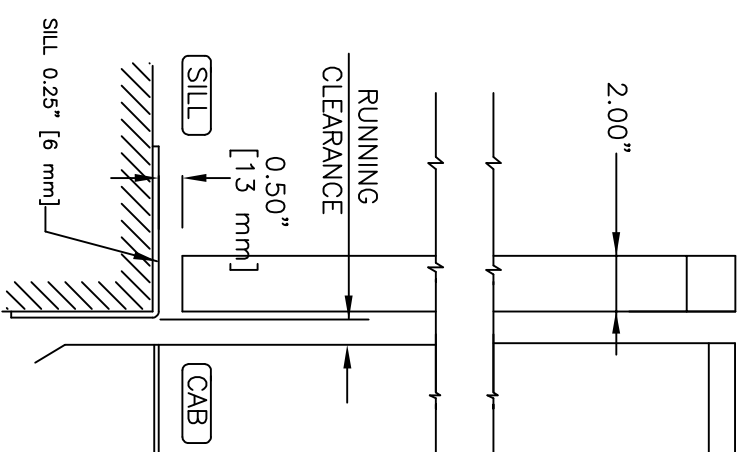

VERTICAL SECTION

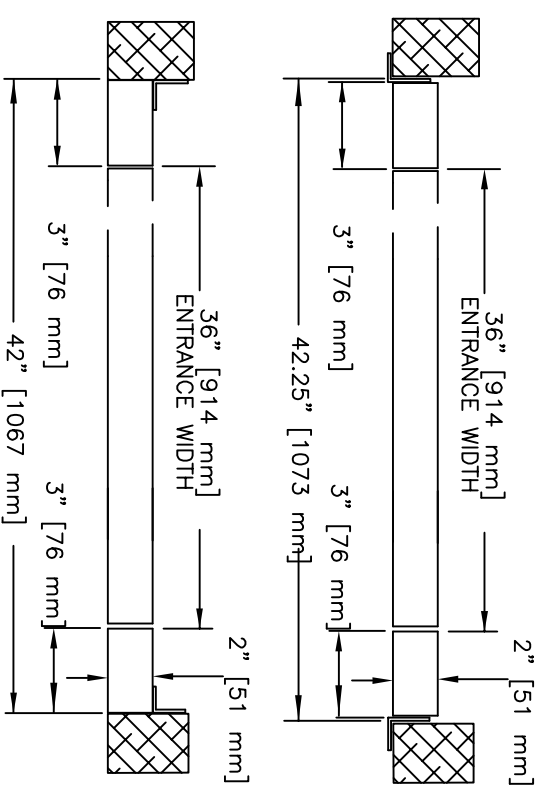

HORIZONTAL SECTION

- NOTES:
- A: DRYWALL OR PARGING (BY OTHERS) AS REQ'D.
  - B: SEE DATASHEET OF THE INSTALLATION DRAWING FOR LANDING ENTRANCE SCHEDULE.
  - C: ALL INFORMATION IS SUBJECT TO CHANGE.

GENERAL INFORMATION:

- EACH LANDING ENTRANCE SHALL BE SUPPLIED AS A FINISHED ASSEMBLY WITH GATE AND FRAME BLANKED, REINFORCED, DRILLED AND TAPPED FOR ALL COMPONENTS DETAILED, READY FOR INSTALLATION.
- DIFFERENT PANEL INSERT MATERIALS ARE OPTIONAL.
- DIFFERENT LOCKS SUCH AS GAL, OR WR500 ARE OPTIONAL.
- MANUAL GATE: HYDRAULIC DOOR CLOSER IS PROVIDED.

Second Level Door


Gates  
VERTICAL WHEELCHAIR PLATFORM LIFT

OFFICE USE ONLY:	
CONFIGURATION VERSION STAMP:	0.0
MODULE VERSION STAMP:	B-5-826


Part No.	V-1504
Variant No.	1029484

CUSTOMER:	ANIBAL ROMERO
PROJECT:	MX - NW COPY
ADDRESS:	N. Street, City
DATE:	10/05/21
REVISION DATE:	10/13/21
COMPLETED BY:	AROMERO

Job No.	P00000
SHEET No.	3 OF 4

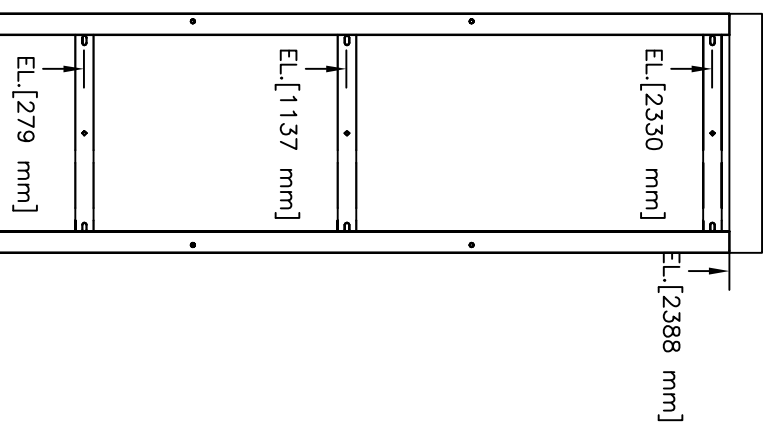

EL: MOUNTING BRACKET POSITION

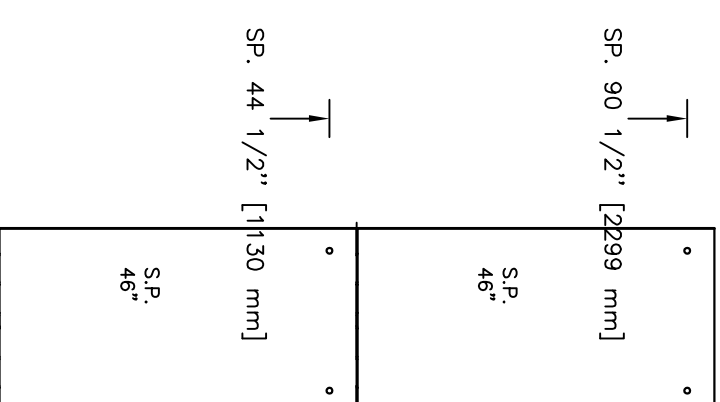

SP: SERVICE PANEL

LOADS CALCULATED ON BASED ON ANCHOR POINTS EVERY 48"  
 EVERY TOWER SECTION NEEDS TO BE ANCHORED. IF SPACING  
 IS INCREASED, LOADS PER BRACKETS WILL INCREASE ACCORDINGLY

**ELEVATION VIEWS**  
 VERTICAL WHEELCHAIR PLATFORM LIFT

OFFICE USE ONLY:	
CONFIGURATION VERSION STAMP:	0.0
MODULE VERSION STAMP:	P-S-826

Part No.	V-1504
Variant No.	1029484

CUSTOMER: ANIBAL ROMERO  
 PROJECT: NW COPY  
 ADDRESS: N O . S t e r e o t e , C i t e



DATE: 10/05/21  
 REVISION DATE: 10/13/21  
 COMPLETED BY: AROMERO

Job No.	P000000	SHEET No.	4 OF 4
---------	---------	-----------	--------



HOISTWAY CEILING NOT REQUIRED (OPTIONAL) ON UNENCLOSED UNITS

# TYPICAL PLAN

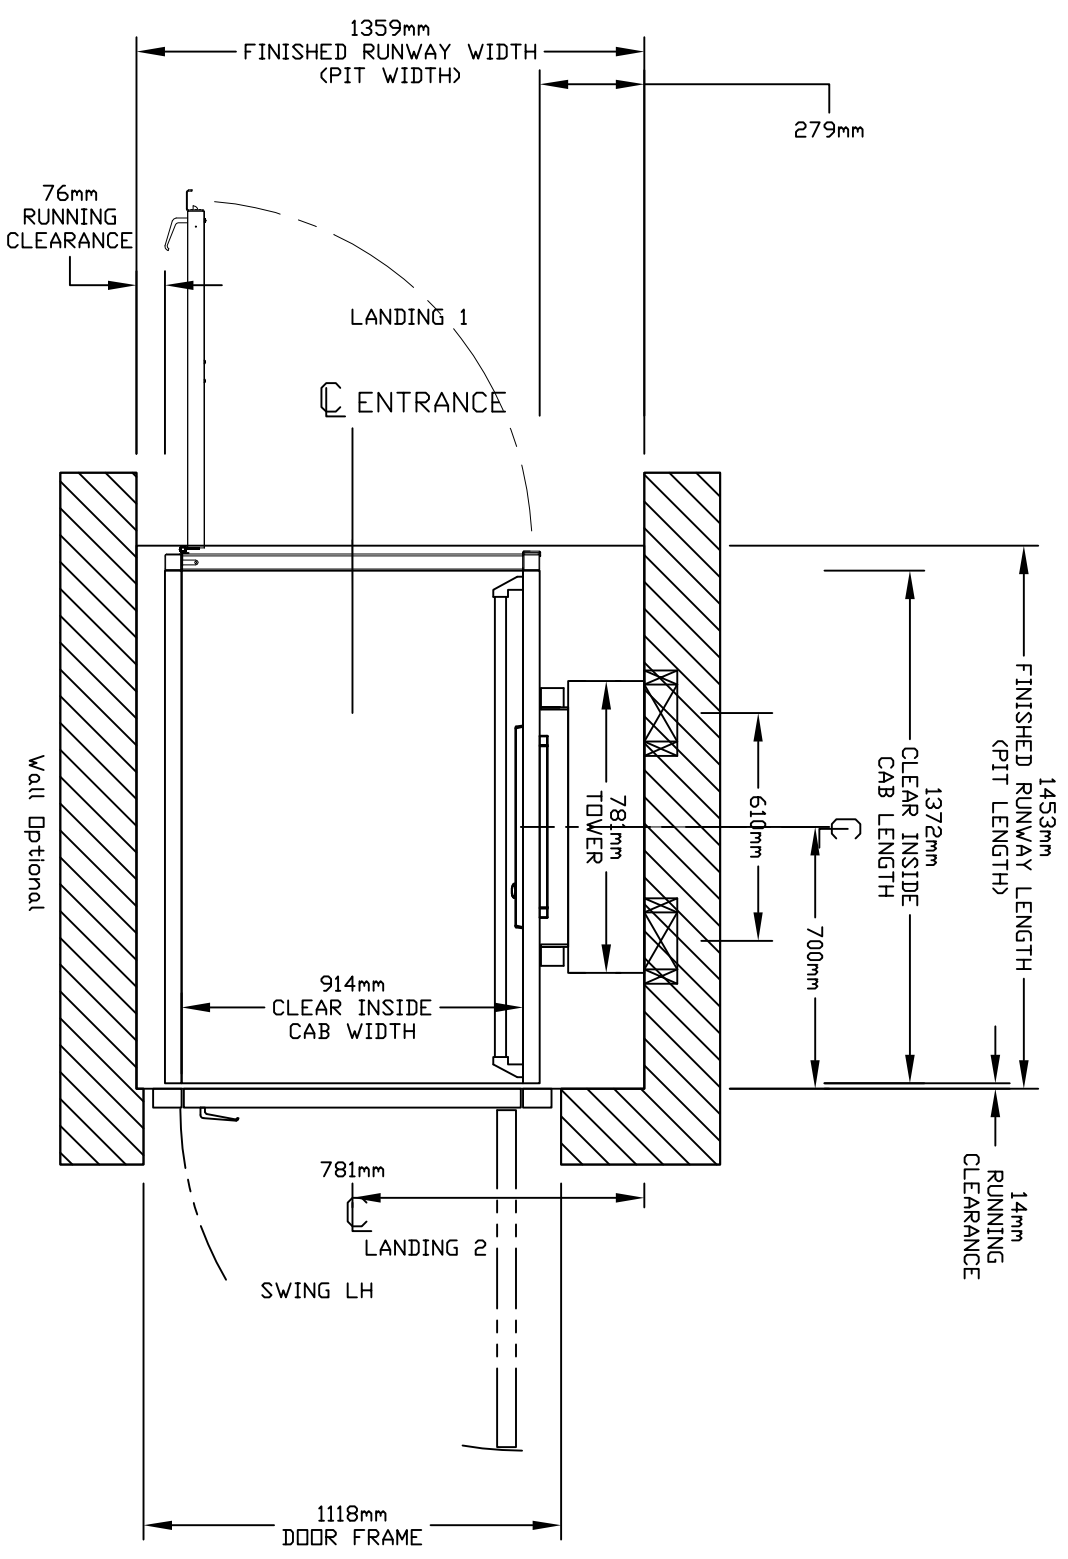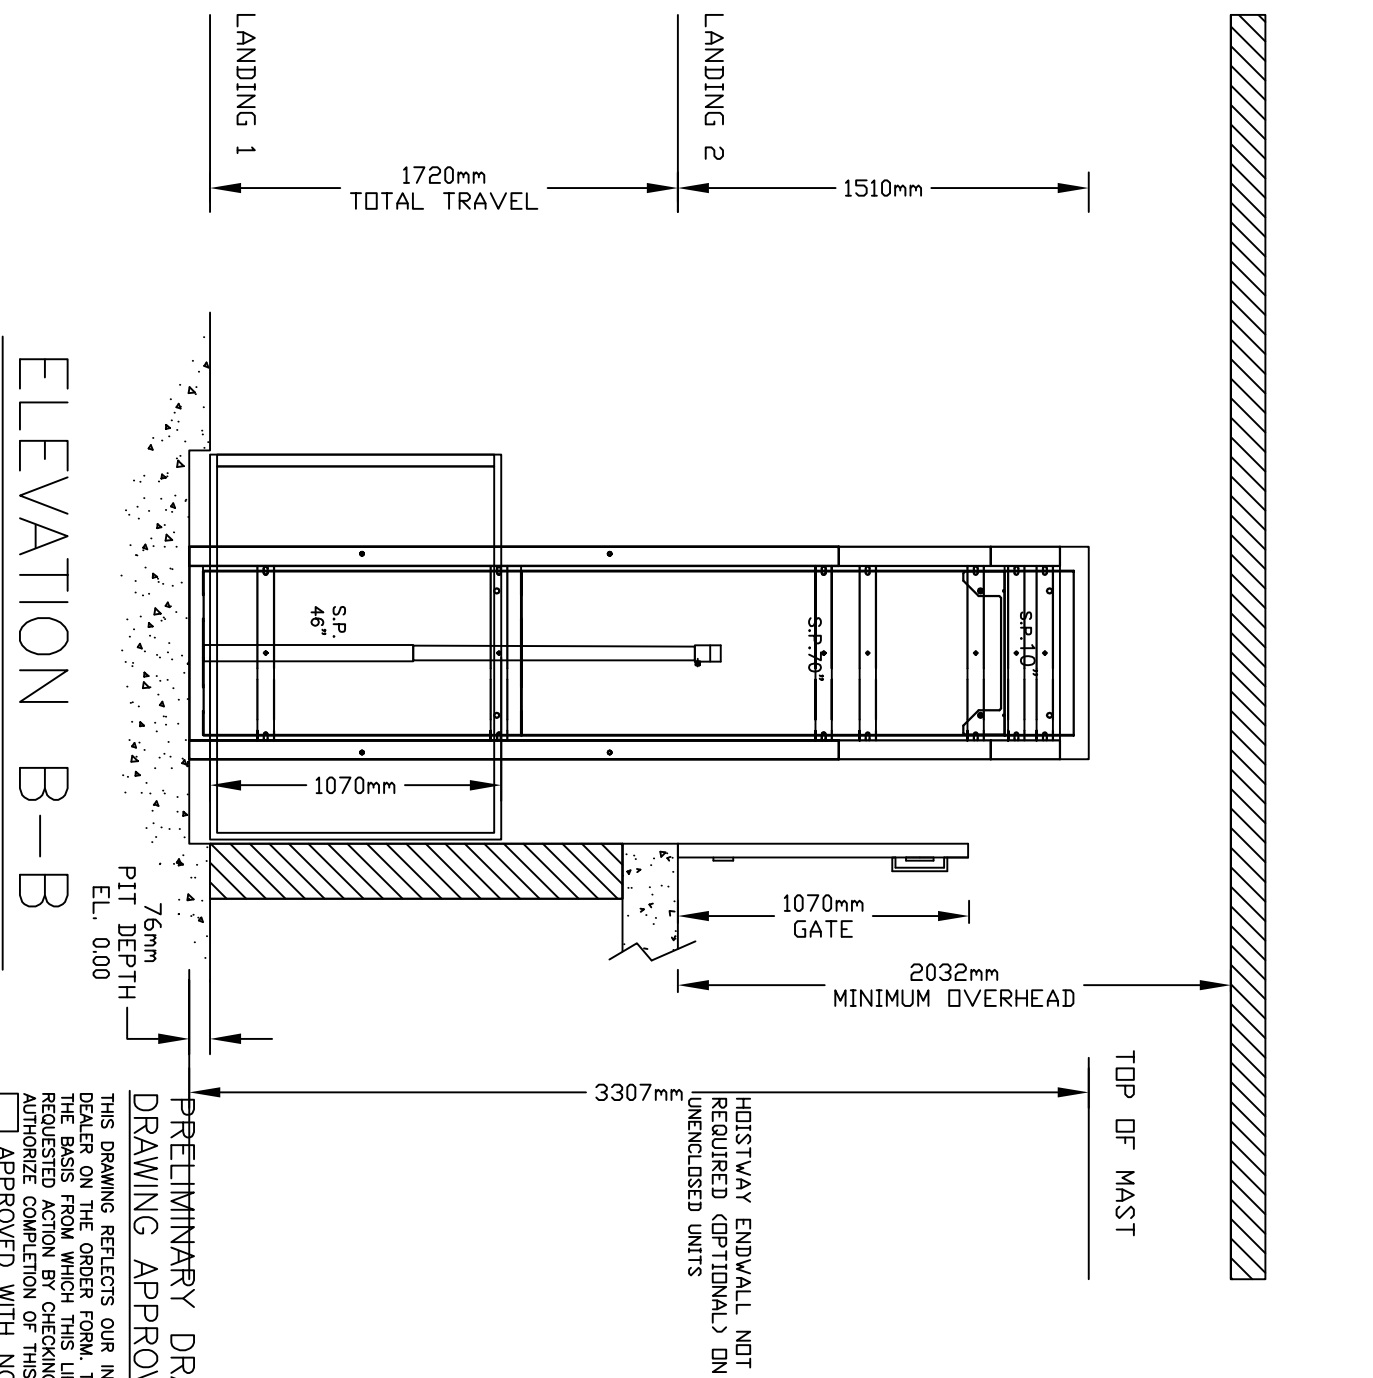

PRELIMINARY DRAWING ONLY  
DRAWING APPROVAL:

THIS DRAWING REFLECTS OUR INTERPRETATION OF THE INFORMATION PROVIDED BY THE DEALER ON THE ORDER FORM. THIS INFORMATION IS THE DEALER'S RESPONSIBILITY, AND IS THE BASIS FROM WHICH THIS LIFT IS DESIGNED AND MANUFACTURED. PLEASE INDICATE THE REQUESTED ACTION BY CHECKING ONE OF THE FOLLOWING BOXES AND SIGNING BELOW TO AUTHORIZE COMPLETION OF THIS ORDER.

APPROVED WITH NO EXCEPTIONS  
MANUFACTURE PRODUCT AS PER DRAWING

APPROVED WITH EXCEPTIONS, NO REAPPROVAL  
REQUIRED  
MAKE CHANGES AS NOTED, NO REAPPROVAL DRAWING REQUIRED


CHANGE AS NOTED, REAPPROVAL REQUIRED  
MAKE CHANGES AS NOTED, SEND CORRECTED DRAWING FOR  
REAPPROVAL BEFORE MANUFACTURE

CHANGES REQUEST:


- \_\_\_\_\_
- \_\_\_\_\_
- \_\_\_\_\_
- \_\_\_\_\_

SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

CAUTION: ONCE THE DRAWING IS APPROVED, JOB CANCELLATION FEES WILL APPLY.

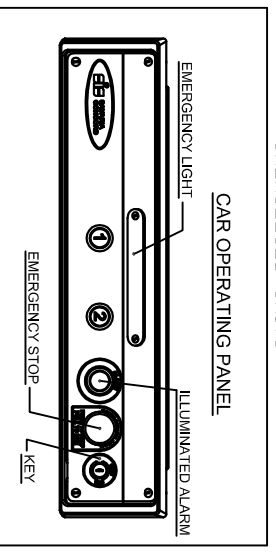

HOISTWAY ENDWALL NOT  
REQUIRED (OPTIONAL) ON  
UNENCLOSED UNITS

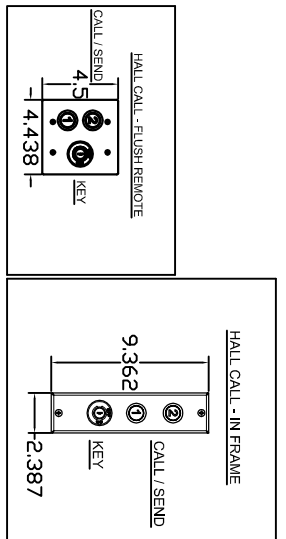

GENERAL ARRANGEMENT  
VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER: ANIBAL ROMERO  
PROJECT: MX - NW  
ADDRESS: \_\_\_\_\_

DATE: 09/29/21  
REVISION DATE: 10/13/21  
COMPLETED BY: AROMERO

OFFICE USE ONLY:  
CONFIGURATION VERSION STAMP: 0.0  
MODULE VERSION STAMP: P-5426

Part No. V-1504  
Variant No. 1028916

**savarida.**

JOB No. P000000

SHEET No. 1 OF 4



# PROVISIONS BY OTHERS

# SPECIFICATIONS

## GENERAL

**HOISTWAY** – THE HOISTWAY MUST BE DESIGNED AND BUILT IN ACCORDANCE WITH "LIFTS FOR PERSONS WITH PHYSICAL DISABILITIES" OR "PRIVATE RESIDENCES LIFTS FOR PERSONS WITH PHYSICAL DISABILITIES" AND ALL PROVINCIALS AND LOCAL CODES.

**PLUMB RUNWAY** – DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY AND PIT (WHERE PROVIDED) ARE LEVEL, PLUMB (-/+ 1/8" (3 mm)) AND SQUARE AND ARE IN ACCORDANCE WITH THE DIMENSIONS ON THESE DRAWINGS.

**MINIMUM OVERHEAD CLEARANCE** – OWNER/AGENT MUST ENSURE MINIMUM OVERHEAD CLEARANCE IS IN COMPLIANCE WITH CODES.

**CONSTRUCTION SITE** – OWNER/AGENT TO PROVIDE ALL MASONRY, CARPENTRY AND DRYWALL WORK AS REQUIRED AND SHALL PATCH AND MAKE GOOD (INCLUDING FINISH PAINTING) ALL AREAS WHERE WALLS/FLOORS MAY REQUIRE TO BE CUT, DRILLED OR ALTERED IN ANY WAY TO PERMIT THE PROPER INSTALLATION OF THE LIFT.

**DIMENSIONS** – CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

## STRUCTURAL

**FLOOR/SUPPORT WALL LOADS** – CONTRACTOR TO ASSURE THAT BUILDING AND SHAFT WILL SAFELY SUPPORT ALL LOADS IMPOSED BY THE LIFT EQUIPMENT. REFER TO THE LOAD DIAGRAM ON THIS DRAWING.

**MAST TO BE SECURELY FASTENED** – WHERE REQUIRED THE MAST MUST BE SECURELY FASTENED TO THE STRUCTURAL SUPPORT WALL. REFER TO WALL / FLOOR SUPPORT LOAD DIAGRAM AND WALL LAG DIMENSIONS ON THIS DRAWING.

**WHERE DOORS ARE REQUIRED** – SUITABLE LINTELS MUST BE PROVIDED BY OWNER/AGENT. DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS.

## ELECTRICAL

**GENERAL** – ELECTRICAL EQUIPMENT AND WIRING TO COMPLY WITH SECTION 38 OF CSA C22.1 (CANADA) OR SECTION 620 OF NEC ANSI/NFPA 70 (USA).

**POWER SUPPLY** – 120VAC, 20A, 60HZ, 1PH CIRCUIT THROUGH A FUSE DISCONNECT WITH AUXILIARY CONTACT ON MAIN POWER SUPPLY. PROVIDE TWO 18 AWG CONDUCTORS BETWEEN CONTACT AND CONTROLLER.

**LIGHTING** – LIGHTING OF 100 LX MIN. AT PLATFORM AND LANDINGS. LIGHTING WITH SWITCH AND ELECTRICAL GFCI OUTLET IN HOISTWAY PIT.

**PHONE** – IF A TELEPHONE CIRCUIT IS REQUIRED, JACK OR PHONE ARE PROVIDED ON THE CAR. A DEDICATED ANALOG PHONE LINE (NO VOIP) IS REQUIRED TO BE PROVIDED BY OTHERS TO THE CONTROLLER FOR VOIP, PLEASE CONTACT SAVARIA.

**SAVARIA LINK REMOTE MONITORING** – NOT APPLICABLE  
Not required


## ENTRANCES

**UPPER LANDING GATES** – WHERE REQUIRED, SMOOTH SOLID BARRIERS ARE TO BE SUPPLIED AND INSTALLED ON BOTH SIDES OF ENTRANCE AT UPPER LEVEL AND MUST BE A MINIMUM OF 42" (1067 mm) HIGH. ENTRANCE ASSEMBLY MUST BE IN PLACE PRIOR TO THIS PROVISION.


**FASCIA PANEL BELOW UPPER LEVEL ENTRANCE** – WHERE REQUIRED, FASCIA PANEL MUST BE FASTENED TO A SOLID WALL AND BE PERPENDICULAR TO THE FLOOR AND WALLS. HOISTWAY FASCIA IS NOT SELF-SUPPORTING FOR LONG, CONTINUOUS RUNS VOID OF ENTRANCES. ADEQUATE SUPPORT FOR THE FASCIA MUST BE PROVIDED.

**ENTRANCE ASSEMBLIES** – ENTRANCE ASSEMBLIES MUST BE ADJUSTED TO ALIGN WITH PLATFORM AND INTERLOCK EQUIPMENT. OTHERS TO ALLOW AN ADEQUATE ROUGH OPENING.

**RETURN WALLS** – RETURN WALLS AT ENTRANCES MUST BE BUILT-IN BY OTHERS AFTER ENTRANCE ASSEMBLIES ARE IN PLACE. ENTRANCE ASSEMBLY MUST BE SECURELY FASTENED TO WALLS.



SIDE A  
SIDE B  
SIDE C

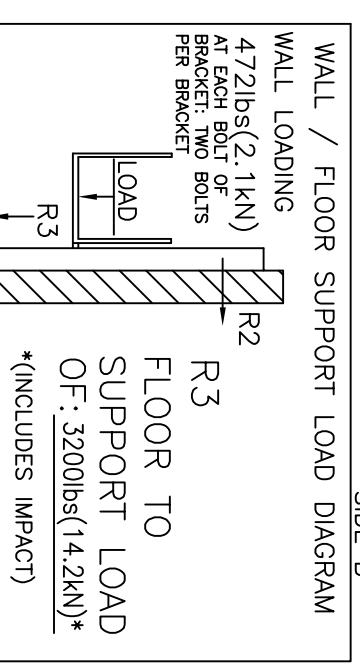

WALL / FLOOR SUPPORT LOAD DIAGRAM  
WALL LOADING  
472lbs(2.1kN)  
AT EACH BOLT OF BRACKET: TWO BOLTS PER BRACKET  
R2  
R3  
FLOOR TO SUPPORT LOAD OF: 3200lbs(14.2kN)\*  
\*(INCLUDES IMPACT)

## GENERAL

**CLASSIFICATION:**  
APPLIED CODE:  
SPECIAL NOTE:  
MODEL:  
CAPACITY:  
NOMINAL SPEED:  
TRAVEL:  
PIT DEPTH:  
PLATFORM SIZE:  
POWER SUPPLY:  
BATTERY BACK UP:

Vertical Wheelchair Platform Lift  
ASME A18.1-2008 Section 5 Priv  
V-1504 Shaftway or Decklift  
750 lbs (341 kg)  
20 fpm (0.102 m/s)  
67.72" (1720 mm)  
3" (76 mm)  
36" X 54" (914 mm X 1372 mm)  
120V,20A,60HZ,SINGLE PHASE  
down direction only

**JACK UNIT**  
STROKE: 36" (914 mm)  
PLUNGER O/D: 1.5" (38 mm)  
CYL. O/D: 2.125" (54 mm)  
CYL. I/D: 1.75" (44 mm)

**CONTROLLER**  
MODEL: V-1504  
TYPE: CPFS  
OPS #: LR1390-7R2  
AMP: 100 A  
MFR.: SAVARIA

## POWER UNIT

MOTOR: 3.0 HP, 24V DC  
FLOW: 1.15 Gal/min (4.35L/min)

## CAB FINISH


STEEL W PAINT

## HYDRAULIC DATA

OIL TYPE: UNIVIS 32 INDOOR DEXRON ATF OUTDOOR  
GALLONS REQ'D: 1.0 Gal (3.79 L)  
MAXIMUM WORKING PRESSURE: 2500 psi (17.2 MPa)  
RELIEF PRESSURE: WPx125% MAX.  
MAXIMUM RELIEF PRESSURE: 2500 psi (17.2 MPa)  
HYDRAULIC HOSE: 1/4" (6.4 mm) ID  
BURST: 20000 psi (137.9 MPa)  
FITTINGS: 1/4" (6.4 mm) NPT MALE

## SUSPENSION CHAIN

2X #50 ROLLER CHAIN  
BREAKING STRENGTH: 7171 lbs (31.9 kN) each  
SAFETY BRAKE: TYPE 'A'

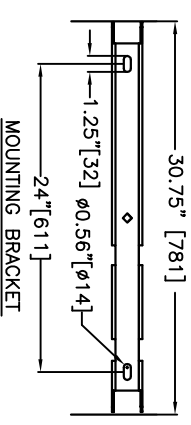

MOUNTING BRACKET

## DOORS / GATES / CALL STATIONS

	LANDING 1	LANDING 2	LANDING 3	LANDING 4
DOOR TYPE	Platform Gate	42" - 1067mm Landing Gate		
ENTRANCE SIDE	d	c		
DOOR SWING	lh	lh		
DOOR INSERT	Tempered Glass	Tempered Glass		
LOCK TYPE	WR500 Lock (24V)	WR500 Lock (24V)		
AUTO DOOR OPENER	None	None		
CUSTOM DOOR WIDTH				
CUSTOM DOOR HEIGHT				
IN FRAME CALL STN.	no	yes		
CALL STN. TYPE	Call/Send Buttons	Call/Send Buttons		
CALL STN. KEYED	Off Pos. Removable	Off Pos. Removable		
CALL STN. STOP BUTTON	no	no		
CALL STN. MOUNTING	Flush Mounted Remote	Flush Mounted In Frame		
INSULATED PRODOOR KIT				



## OPTIONS PROVIDED

EMERGENCY PENDENT PLUG IN MANUAL LOWERING BOX  
WINGS: no  
TOUCH UP PAINT: 1 can(s)  
BUILDING: Private Building  
LIGHT CURTAIN: no  
PHONE OR PHONE PLUG: No Phone, Plug Incl  
FLOOD SWITCH: no  
REMOTE MACHINE ROOM: Not required  
LOCATION: OUTDOOR


OFFICE USE ONLY:	
CONFIGURATION VERSION STAMP:	0.0
MODULE VERSION STAMP:	P-5426

Part No.	V-1504
Variant No.	1028916


## DATA SHEET

CUSTOMER: ANIBAL ROMERO  
PROJECT: MX - NW  
ADDRESS:    
COMPLETED BY: AROMERO  
JOB No. P000000  
SHEET No. 2 OF 4

LOADS CALCULATED ON BASED ON ANCHOR POINTS EVERY 48" EVERY TOWER SECTION NEEDS TO BE ANCHORED. IF SPACING IS INCREASED, LOADS PER BRACKETS WILL INCREASE ACCORDINGLY

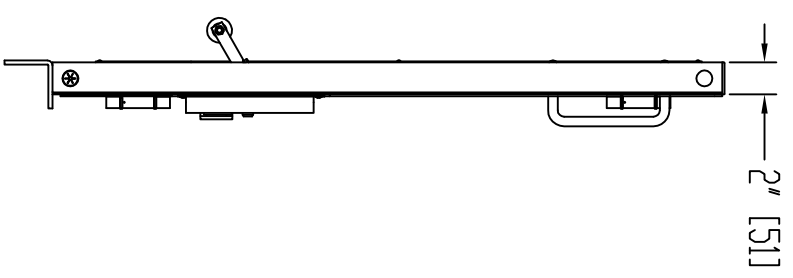


SIDE VIEW




WALL ATTACHMENT  
(8X) #8 X 3 FH SCREWS  
(SHIM AS REQUIRED)




LEFT HAND SWING

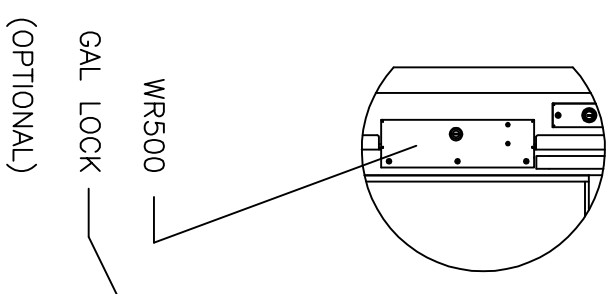


HALL CALL  
(OPTIONAL)

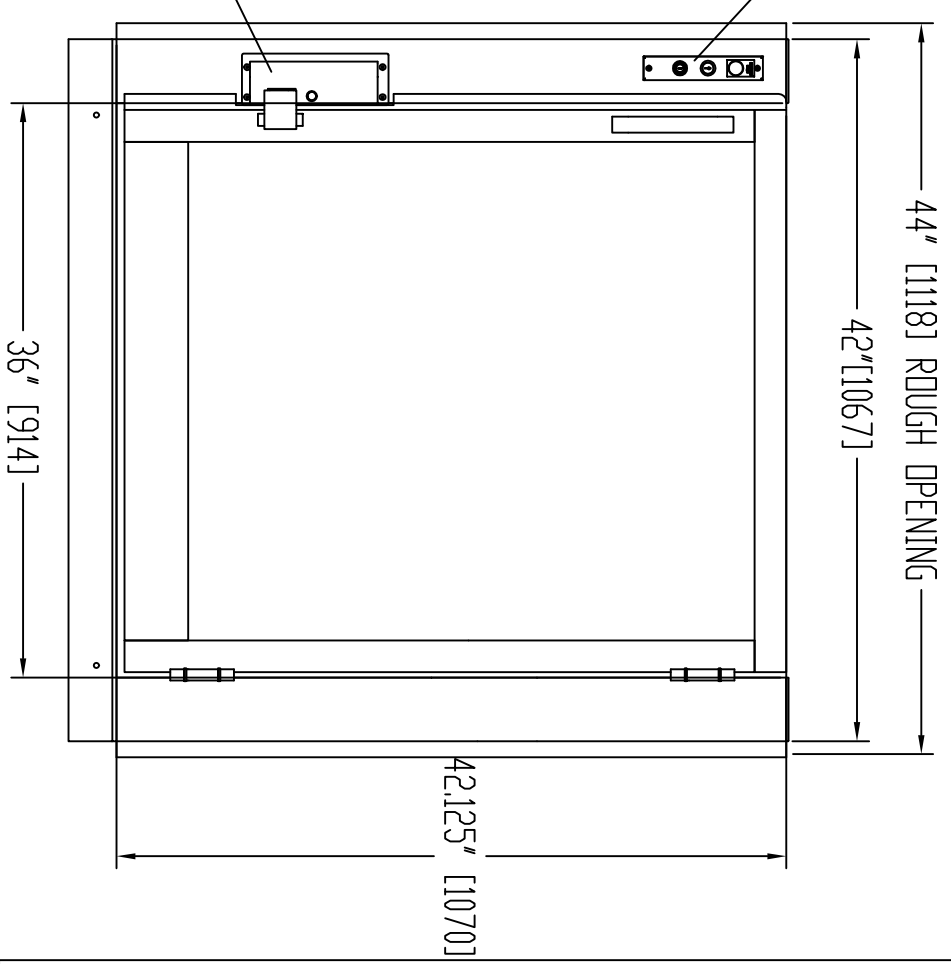


FRONT VIEW

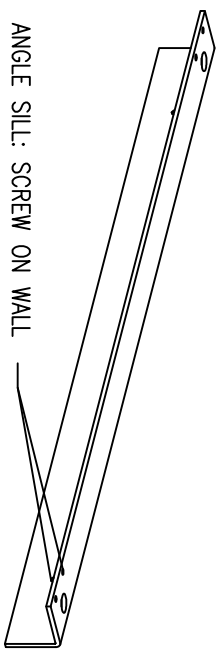

ANGLE SILL: SCREW ON WALL

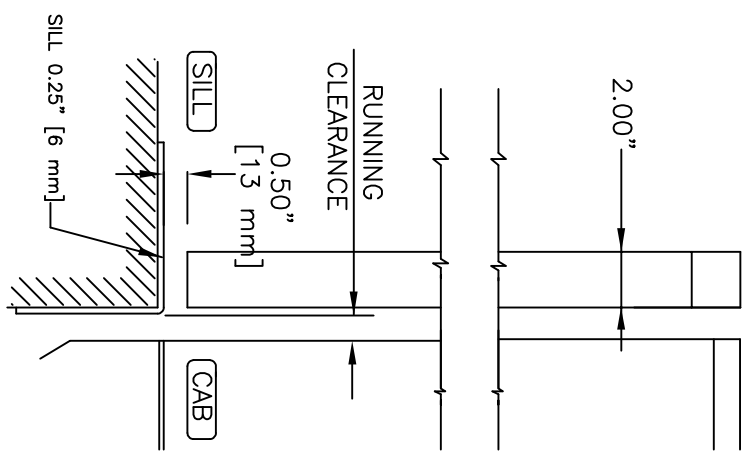

VERTICAL SECTION

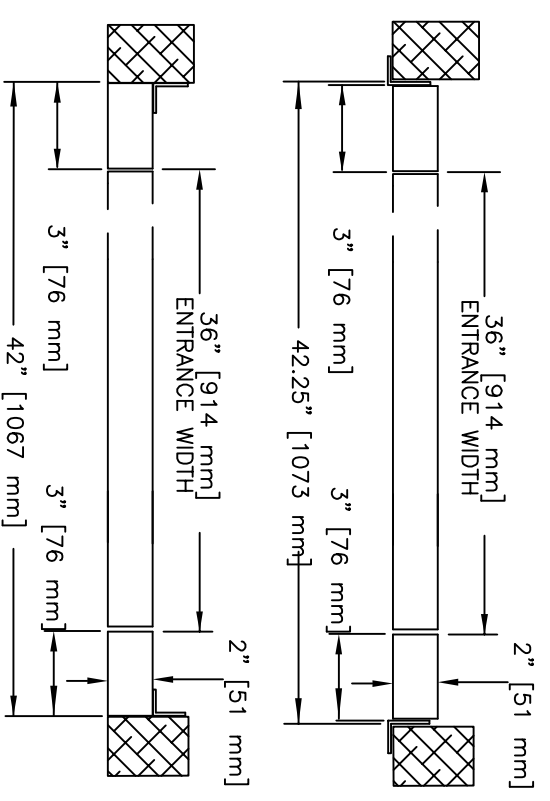

HORIZONTAL SECTION

- NOTES:**
- A: DRYWALL OR PARPING (BY OTHERS) AS REQ'D.
  - B: SEE DATASHEET OF THE INSTALLATION DRAWING FOR LANDING ENTRANCE SCHEDULE.
  - C: ALL INFORMATION IS SUBJECT TO CHANGE.

- GENERAL INFORMATIONS:**
- EACH LANDING ENTRANCE SHALL BE SUPPLIED AS A FINISHED ASSEMBLY WITH GATE AND FRAME BLANKED, REINFORCED, DRILLED AND TAPPED FOR ALL COMPONENTS DETAILED, READY FOR INSTALLATION.
  - DIFFERENT PANEL INSERT MATERIALS ARE OPTIONAL.
  - DIFFERENT LOCKS SUCH AS GAL, OR WR500 ARE OPTIONAL.
  - MANUAL GATE: HYDRAULIC DOOR CLOSER IS PROVIDED.

Second Level Door

**Gates**

VERTICAL WHEELCHAIR PLATFORM LIFT

CUSTOMER: ANIBAL ROMERO  
PROJECT: MX - NW  
ADDRESS: No. Street, City


OFFICE USE ONLY:  
CONFIGURATION VERSION STAMP: 0.0  
MODULE VERSION STAMP: B-5-825

DATE: 09/29/21  
REVISION DATE: 10/13/21  
COMPLETED BY: AROMERO


Part No. V-1504  
Variant No. 1028916

**savarria**

JOB No. P000000 SHEET No. 3 OF 4

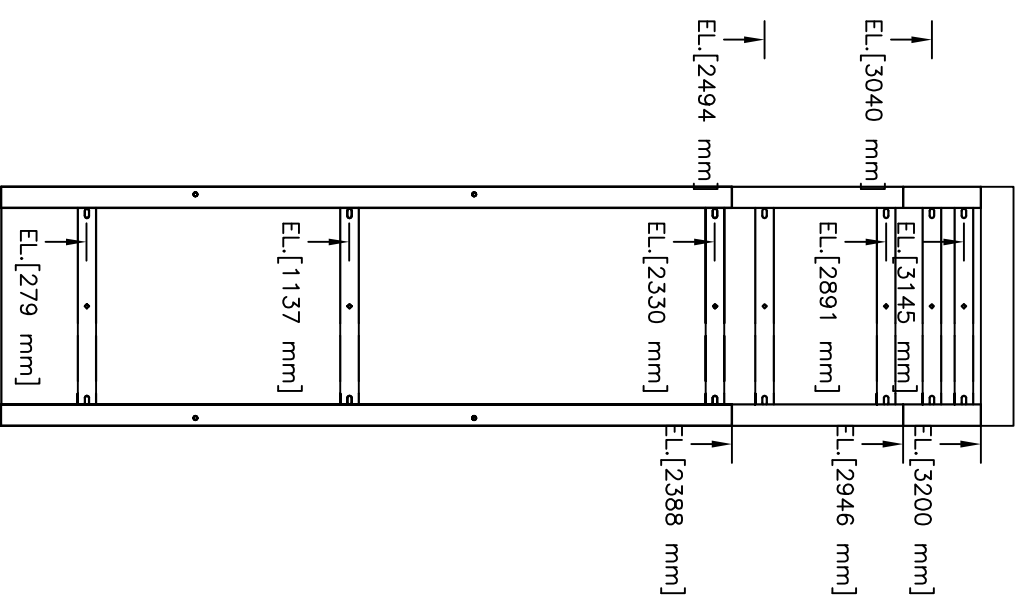

EL: MOUNTING BRACKET POSITION

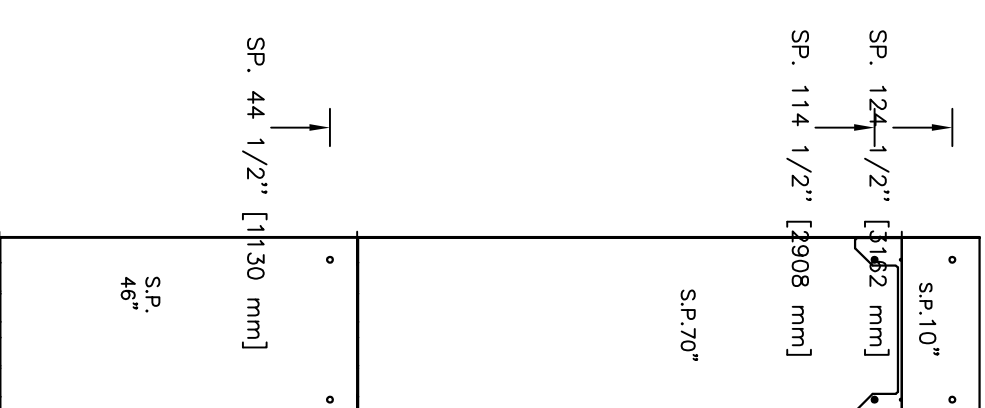

SP: SERVICE PANEL

LOADS CALCULATED ON BASED ON ANCHOR POINTS EVERY 48"  
 EVERY TOWER SECTION NEEDS TO BE ANCHORED. IF SPACING  
 IS INCREASED, LOADS PER BRACKETS WILL INCREASE ACCORDINGLY

**ELEVATION VIEWS**  
 VERTICAL WHEELCHAIR PLATFORM LIFT

OFFICE USE ONLY:		Part No.	V-1504
CONFIGURATION VERSION STAMP:	0.0	Variant No.	1028916
MODULE VERSION STAMP:	B-5-826	DATE:	09/29/21
CUSTOMER:	ANIBAL ROMERO	COMPLETED BY:	AROMERO
PROJECT:	MX - NW	REVISION DATE:	10/13/21
ADDRESS:	N O . S T E R E O T , C I T E	COMPLETED BY:	AROMERO
JOB No.		SHEET No.	
P000000		4 OF 4	